




EARTH FRIENDLY
SINGLE AND DOUBLE COMPARTMENT TANKS

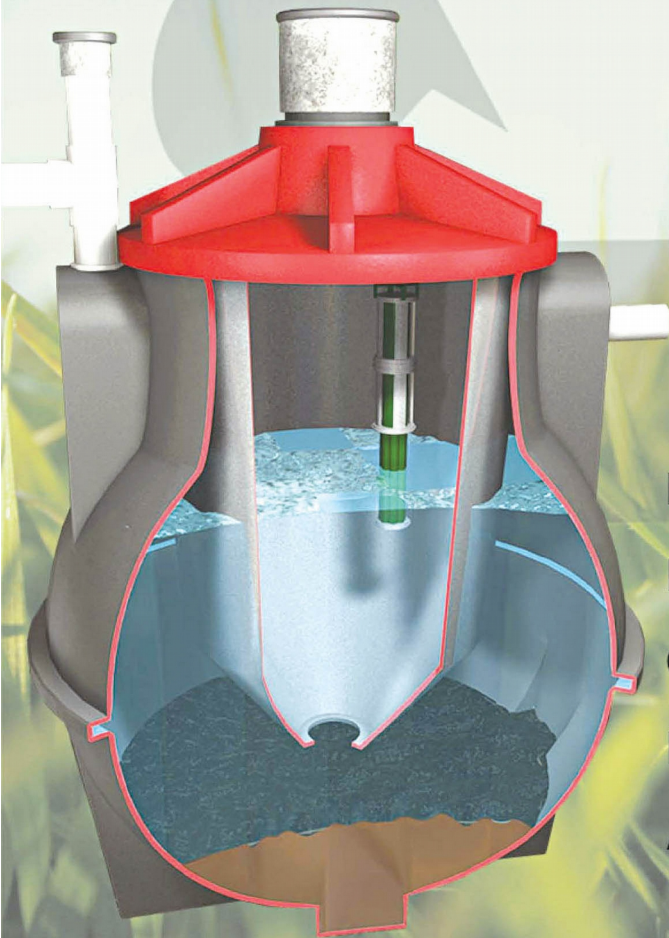

Fully recyclable material

Lifetime guarantee

Cost effective

Easy to install

Available in three sizes



Fat Boy Septic Tanks are rotationally moulded using a mix of recycled and prime grade polyethylene. This formulation combined with the tank's spherical design provides exceptional strength and durability. Our 600 gallon tank contains a second compartment, inspection port and effluent filter, this ensures that no solids enter the soakaway. Tanks can be loined to create larger systems. Our tanks are easy to transport and install. Installation instructions are included with each purchase.

SPECIFICATIONS


SEPTIC TANK	a Total Height	b Diameter	c Height to Inlet	d Height to Outlet
300 Gal	61.25" (156cm)	57" (145 cm)	50" (127 cm)	47.5" (121 cm)
500 Gal	81" (206 cm)	67" (170 cm)	53" (135 cm)	51.25" (130 cm)
600 Gal	85" (216 cm)	67" (170 cm)	68.5" (174 cm)	60.5" (154 cm)
800 Gal	80" (203 cm)	75" (191 cm)	67" (170 cm)	65" (165 cm)




300 Gallons (1.135L)
Max number of users 3
Single Compartment Tank



500 Gallons (1.890L)
Max number of users 5
Single Compartment Tank

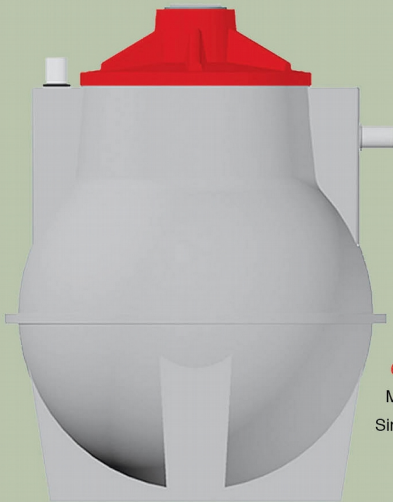


600 Gallons (2.270L)
Max number of users 7
Single Compartment Tank

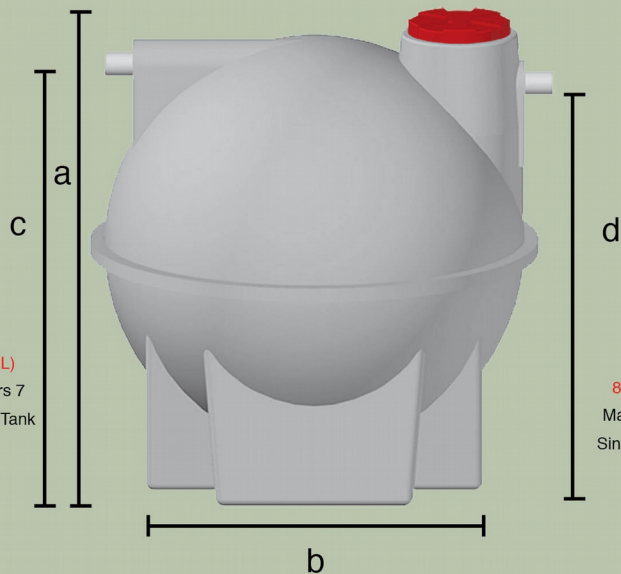


800 Gallons (3.028L)
Max number of users 12
Single Compartment Tank


500 Gallons (1,890L)
Internal view of septic tank installed with riser

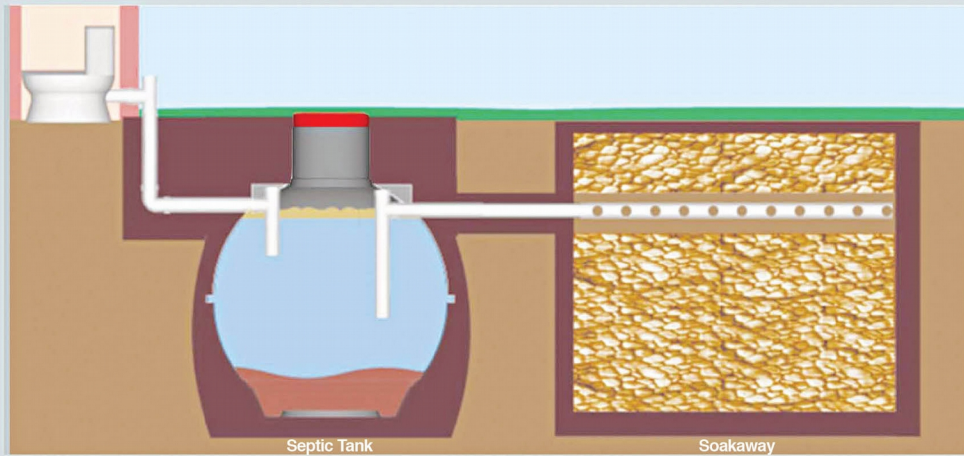

600 Gallons (2,270L)
Internal view of septic tank installed

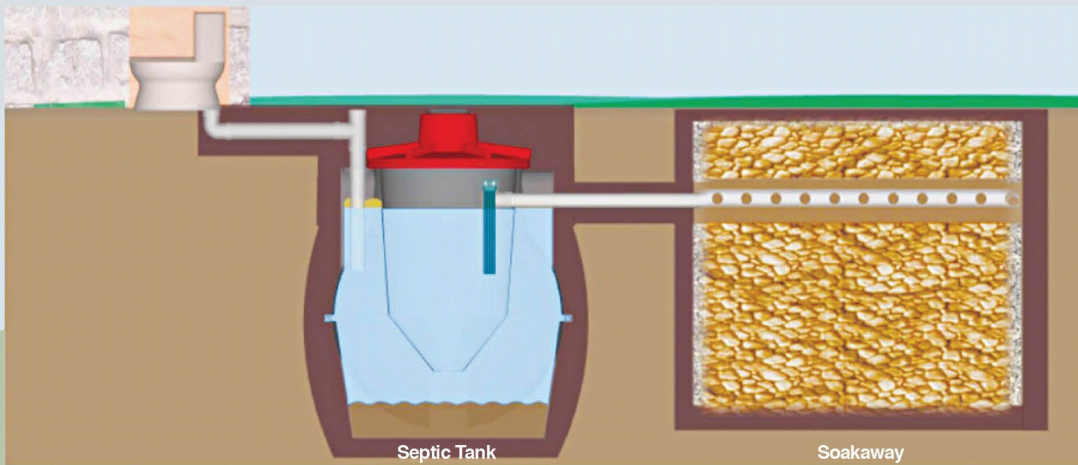

Two Tank System
Internal view of two 600 gallon tanks joined to create a larger system

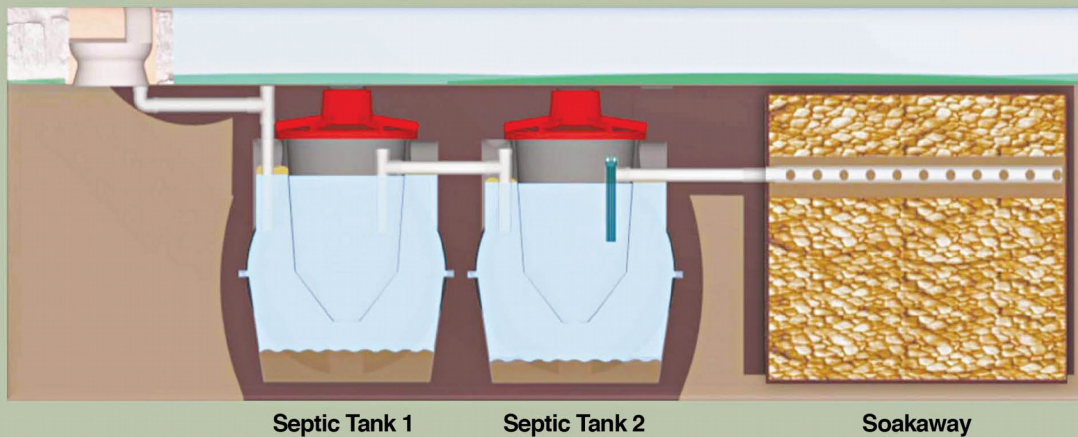

FREQUENTLY ASKED QUESTIONS

SHOULD THE SEPTIC TANKS BE FILLED WITH WATER?

Yes, the tanks should be filled with water during the installation process. The water should not be removed after installation. Septic tanks may collapse if left empty underground.

HOW LONG IS THE SEPTIC TANK EXPECTED TO LAST?

Once installed according to our installation instructions and routine maintenance is undertaken, our septic tanks can last A lifetime.

WHEN SHOULD A SEPTIC TANK BE CLEANED?

Generally, our septic tanks should be pumped every 3 - 5 years based on the maximum number of users. However, depending on the water usage and the amount of waste entering the system, this may vary.
*Choosing a larger tank may decrease the frequency of pump outs.

HOW OFTEN SHOULD THE EFFLUENT FILTER BE CLEANED?

The effluent filter should be cleaned every 6 months or more frequently as required. It is also recommended that the septic tank be inspected every 12 - 18 months.

CAN THE TANKS BE INSTALLED IN HIGH TRAFFIC AREAS?

Yes, our tanks can be installed in high traffic areas but a concrete enclosure must be built so that no loads are transmitted directly onto the tank. A manhole access cover should be used with the concrete enclosure.



Lot C, Don Miguel Ext. Rd.,

San Juan, Trinidad

Tel: (868) 674-TANK (8265)

Fax: (868) 674-8339

WEBSITE: www.rotoplastics.co.tt